


DIAGRAMME ELECTRIQUE CONTROLE BI-ENERGIE BCEH
 WIRING DIAGRAM, DUAL ENERGY CONTROL BCEH

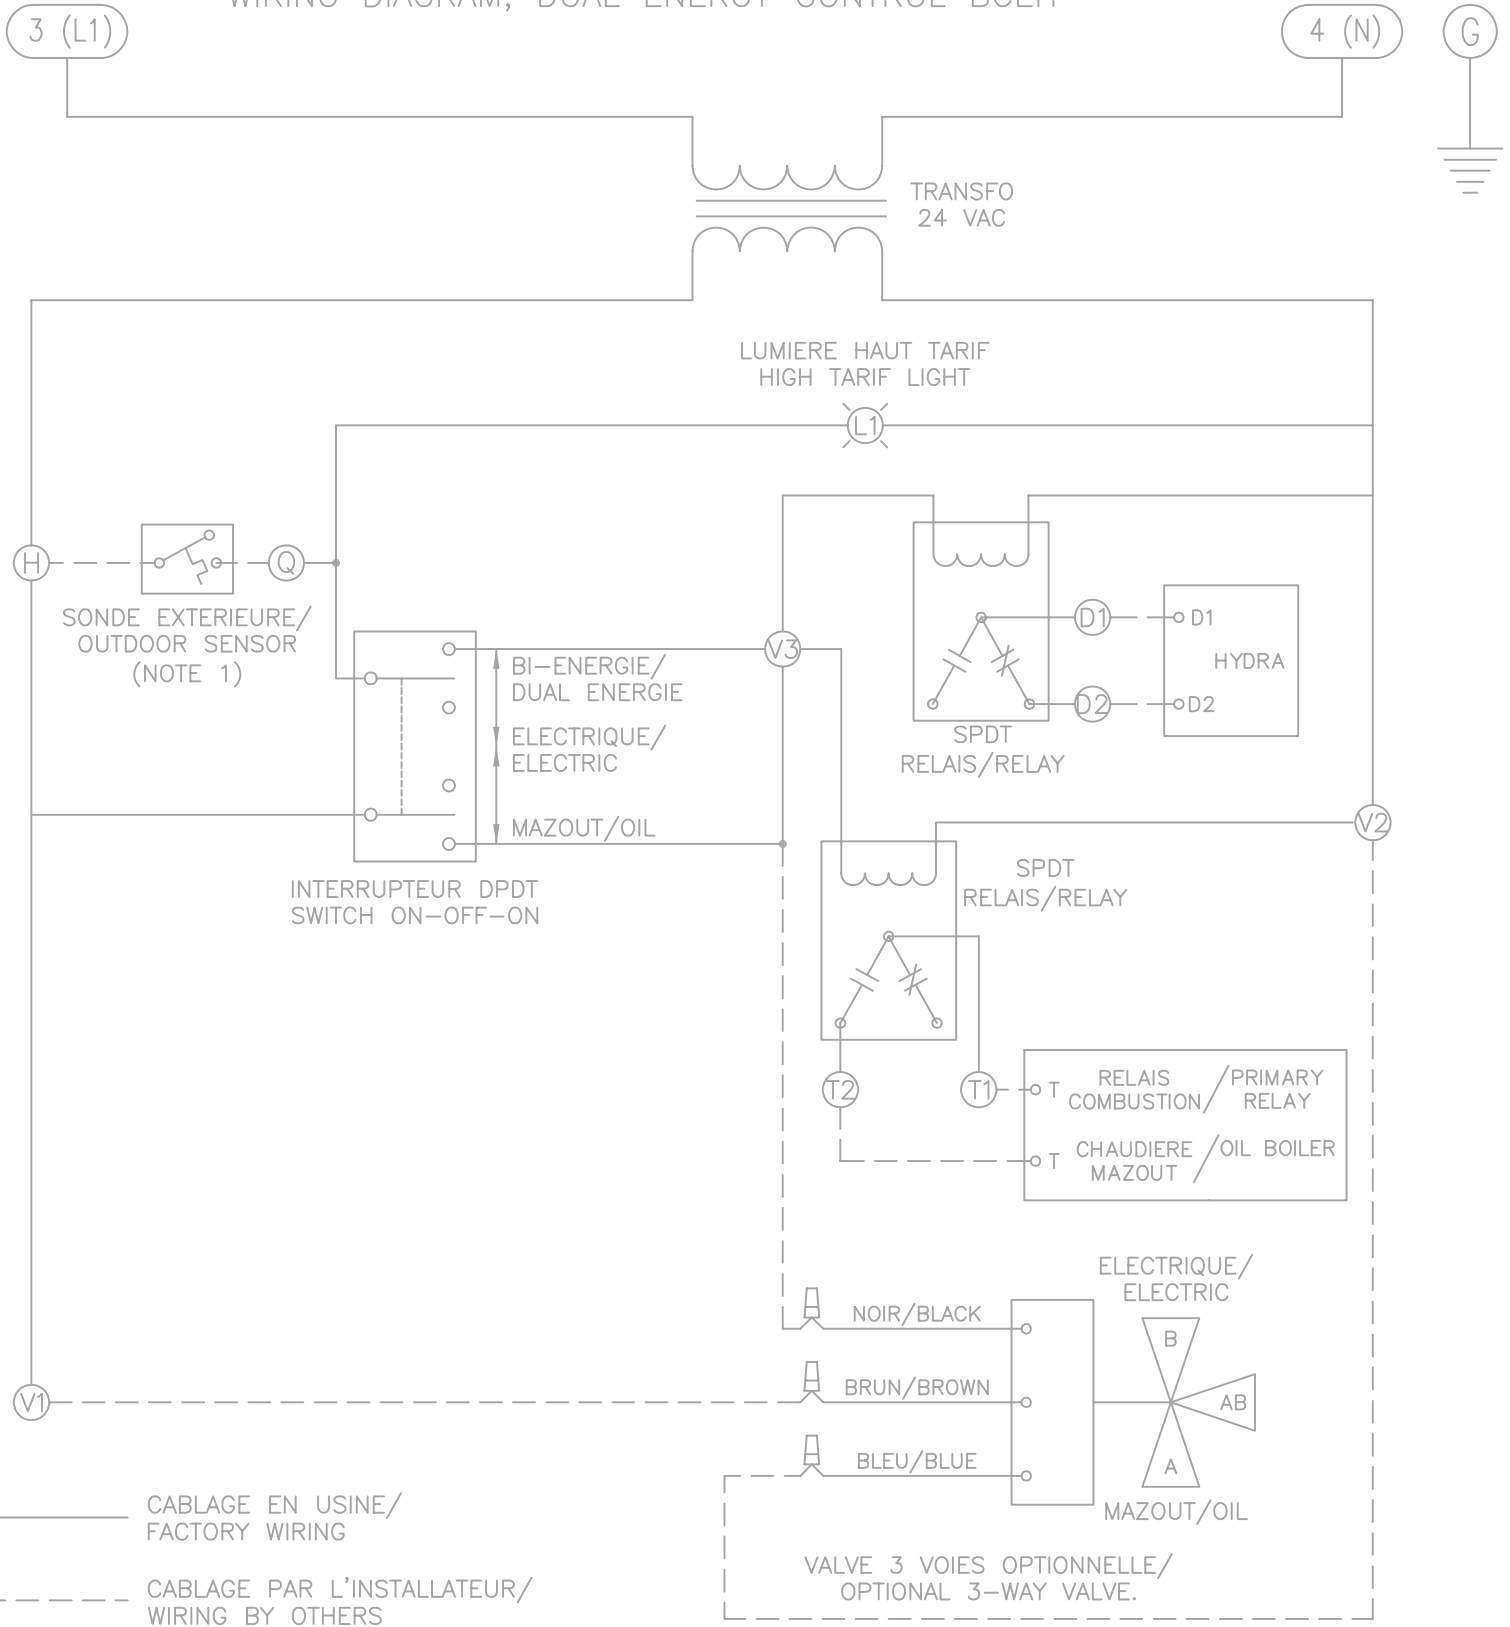

NOTE 1: CONTACT FERME SUR UNE BAISSSE DE TEMPERATURE/
CONTACT CLOSES UPON DROP IN TEMPERATURE

NOTE 2: AFIN DE S'ASSURER DE RENCONTRER LES NORMES DE SECURITE, L'ALIMENTATION ELECTRIQUE DU
 BCEH DOIT PROVENIR DES BORNES 3 ET 4 DE L'HYDRA, OU D'UNE SOURCE INDEPENDANTE./
 IN ORDER TO ENSURE THAT SAFETY REGULATIONS ARE MET, ELECTRIC POWER TO THE BCEH MUST
 COME FROM TERMINALS 3 AND 4 ON THE HYDRA, OR FROM AN INDEPENDANT SOURCE.